



CAPS / PLUGS

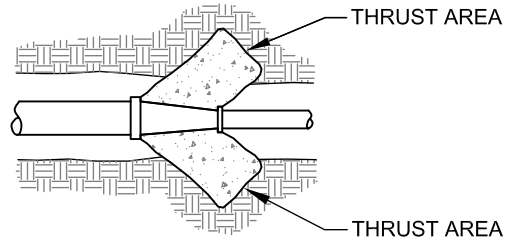


REDUCERS

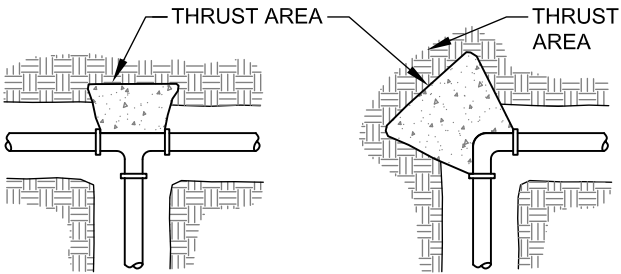

TEES

ELLS

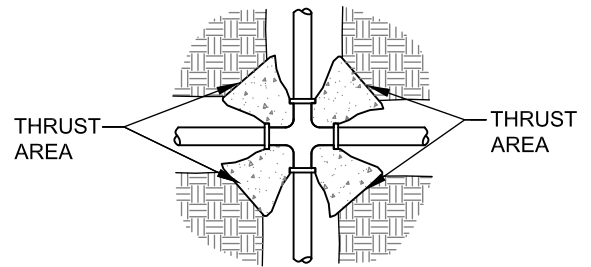

CROSSES

FITTING SIZES	BEARING AREA OF BLOCK IN SQUARE FEET			
	TEES & ENDS	90° BEND	45° BEND	22.5° BEND
4"	1-1/2	2	1-1/2	1-1/2

ALL BLOCKING SHALL BE Poured AGAINST FIRM UNDISTURBED SOIL.
 SOIL BEARING PRESSURE SHALL EXCEED 4,500 LB PER SQUARE FOOT
 FOR ABOVE AREAS.

SECTION

NTS

CITY OF REDMOND, WASHINGTON	 	STANDARD DETAILS
APPROVED BY: RON GRANT CITY ENGINEER		THRUST BLOCK
REVISION DATE: MARCH 01, 2010	City of Redmond WASHINGTON	FILE NAME: SD923.DWG DETAIL NUMBER: 923